



**OPERATION PERMIT REVISION AND
EXISTING SYSTEM APPROVAL FOR WASTEWATER SYSTEM
CHATHAM COUNTY PUBLIC HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
80 EAST ST., P.O. BOX 130 - PITTSBORO, NC 27312-0130
PHONE 919-542-8208 / FAX 919-542-8288
www.chathamnc.org/environmentalhealth**

Date: 06/30/2025

Owner: ANIA ONN, LLC
911 Address: 1838 ALEX COCKMAN RD. PITTSBORO, NC 27312
Parcel Number: 60108 (Parent)
Subdivision Name: N/A
Subdivision Lot: 3

FACILITY

Facility Type: Single Family Residence
Number of Bedrooms: 3 Number of Occupants: 6 max Other: N/A
Design Flow: 360 GPD
Engineering Design with Low-Flow Fixtures/Technologies: No (if yes, see attached certification)
Design Wastewater Strength: Domestic Effluent Standard: DSE
Initial System Type: IIa - Conventional, ≤ 750 linear feet
Repair System Type: IIb - Single Pump
Type of Water Supply: Private Well
Management Entity Required: No
Minimum O&M Requirements: N/A

INSTALLATION SPECIFICATIONS


Wastewater System Installed: Conventional
Nitrification Line: Length: 400 ft. Width: 3 ft. Depth: 24 in. on downslope sidewall
Installer: Certification #:

OP CONDITIONS / COMMENTS: Permit revised for subdivision of property. See attached map for the existing system and repair area location on the new 2.7 acres parcel.

Owners of systems requiring routine inspection by the Chatham County Public Health Department are required to pay an annual county monitoring fee. Operation Permit holders are responsible for notifying subsequent owners of operation permit requirements. The requirements of 15A NCAC 18E are incorporated by reference into this permit and shall be met. This Operation Permit is subject to compliance with the provisions of 15A NCAC 18E, or 15A NCAC 18A .1900, as applicable, and to the conditions of this permit.

Issued by: James Carl Kirtt
Registered Environmental Health Specialist



*See attached site sketch.

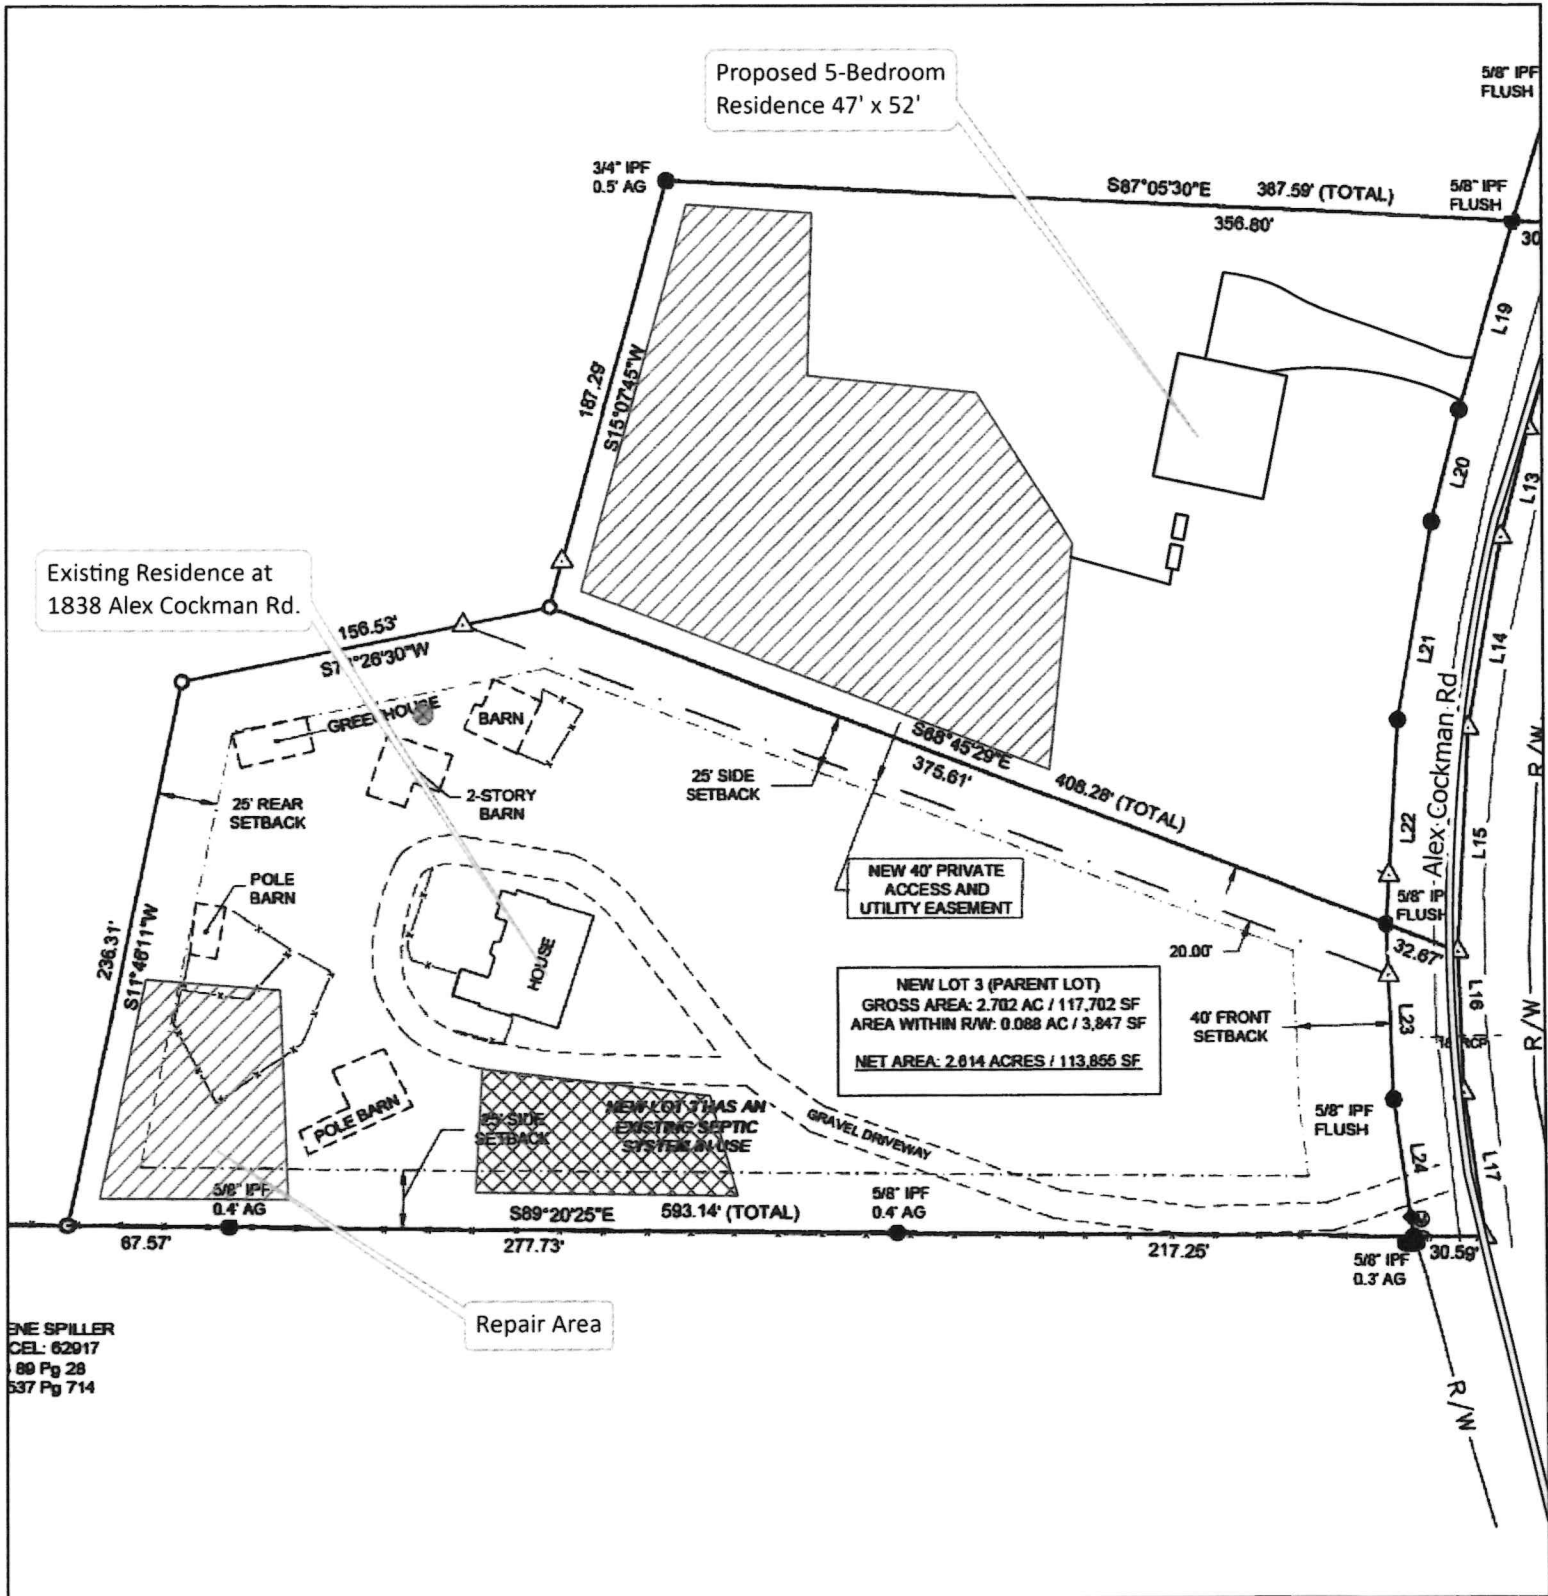

Legend

- Existing Well
- ▨ Existing System Area
- ▨ Approved System Area
- Road Centerlines

Value



REHS: _____

Date: 06/30/2025